



SERIES 4600F 8 x 6 x 12.5 F

FILE NO: F46.57
DATE: Dec. 21, 2006
SUPERSEDES: F46.57
DATE: July 6, 2006


HSC Pump

ELECTRIC DRIVEN

SUBMITTAL

JOB: _____	REPRESENTATIVE: _____
_____	_____
_____	_____
ENGINEER: _____	ORDER NO: _____ DATE: _____
CONTRACTOR: _____	SUBMITTED BY: _____ DATE: _____
	APPROVED BY: _____ DATE: _____

TAG/REF:									DWG#
PUMP DATA	FLOW	HEAD	MOTOR DATA	HP	RPM	VOLT	PH	Hz	ENCLOSURE
SPECIAL STARTING:									

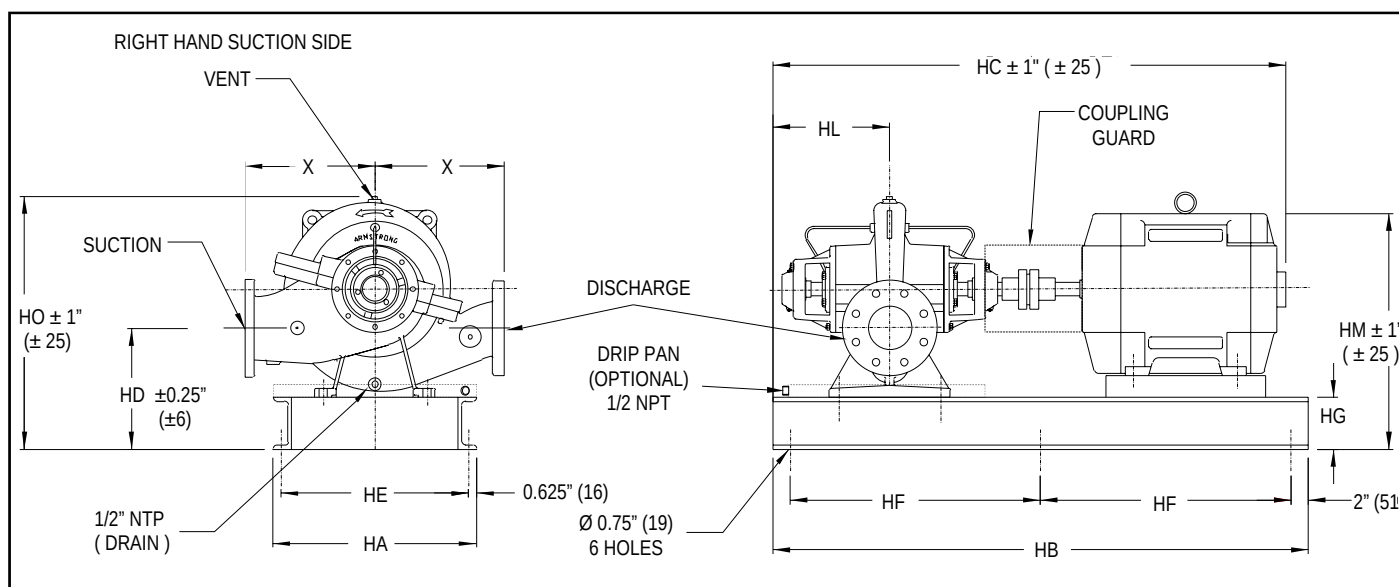

MOTOR FRAME	DIMENSIONS (in.)											WEIGHT lbs.
	HA	HB	HC	HE	HF	HG	HL	X	HM	HO	HD	
324TS	19	58	56.94	17.75	27	4	13.50	15.00	24.44	25.50	10.75	1165
326TS	19	58	58.44	17.75	27	4	13.50	15.00	24.44	25.50	10.75	1195
364TS	19	64	59.69	17.75	30	4	13.50	15.00	25.25	25.50	10.75	1360
365TS	19	64	60.69	17.75	30	4	13.50	15.00	25.25	25.50	10.75	1390
404TS	19	64	63.56	17.75	30	4	13.50	15.00	25.25	25.50	10.75	1540
444TS	25	70	65.00	23.75	33	4	13.50	15.00	27.50	25.50	10.75	1960
445TS	25	70	67.00	23.75	33	4	13.50	15.00	27.50	25.50	10.75	2060
447TS	25	80	70.50	23.75	38	4	13.50	15.00	27.50	25.50	10.75	2550

- FLANGE RATING
- ☐ ANSI 125# STD (1)
 - ☐ ANSI 125# SUCTION
 - ☐ ANSI 250# DISCHARGE
 - ☐ ANSI 250# SUCTION
 - ☐ ANSI 250# DISCHARGE
 - ☐ PN 16
- FIRE PUMP LISTING
- ☐ UL
 - ☐ ULC
 - ☐ FM

NOTE:

(1) STD. DISCHARGE FLANGE THICKNESS ANSI 250#

(2) COUPLING GUARD NOT SHOWN

DO NOT USE FOR CONSTRUCTION UNLESS CERTIFIED

TO BE INDICATED BY CUSTOMER
SUCTION SIDE (VIEWED FROM DRIVER END)

☐ RIGHT HAND (SHOWN) ☐ LEFT HAND

S. A. Armstrong Limited
23 Bertrand Avenue
Toronto, Ontario
Canada, M1L 2P3
T: (416) 755-2291
F (Main): (416) 759-9101

Armstrong Pumps Inc.
93 East Avenue
North Tonawanda, New York
U.S.A. 14120-6594
T: (716) 693-8813
F: (716) 693-8970

Armstrong Holden Brooke Pullen
Wenlock Way
Manchester
United Kingdom, M12 5JL
T: +44 (0) 161 223 2223
F: +44 (0) 161 220 9660



© S.A. Armstrong Limited 2006

For Armstrong locations worldwide, please visit www.armstrongpumps.com